


Use the **TPX Series** to Surge Protect:

1. Service Entrance Disconnect
2. Generator Feed at Transfer Switch
3. At Generator
4. Downstream Panels

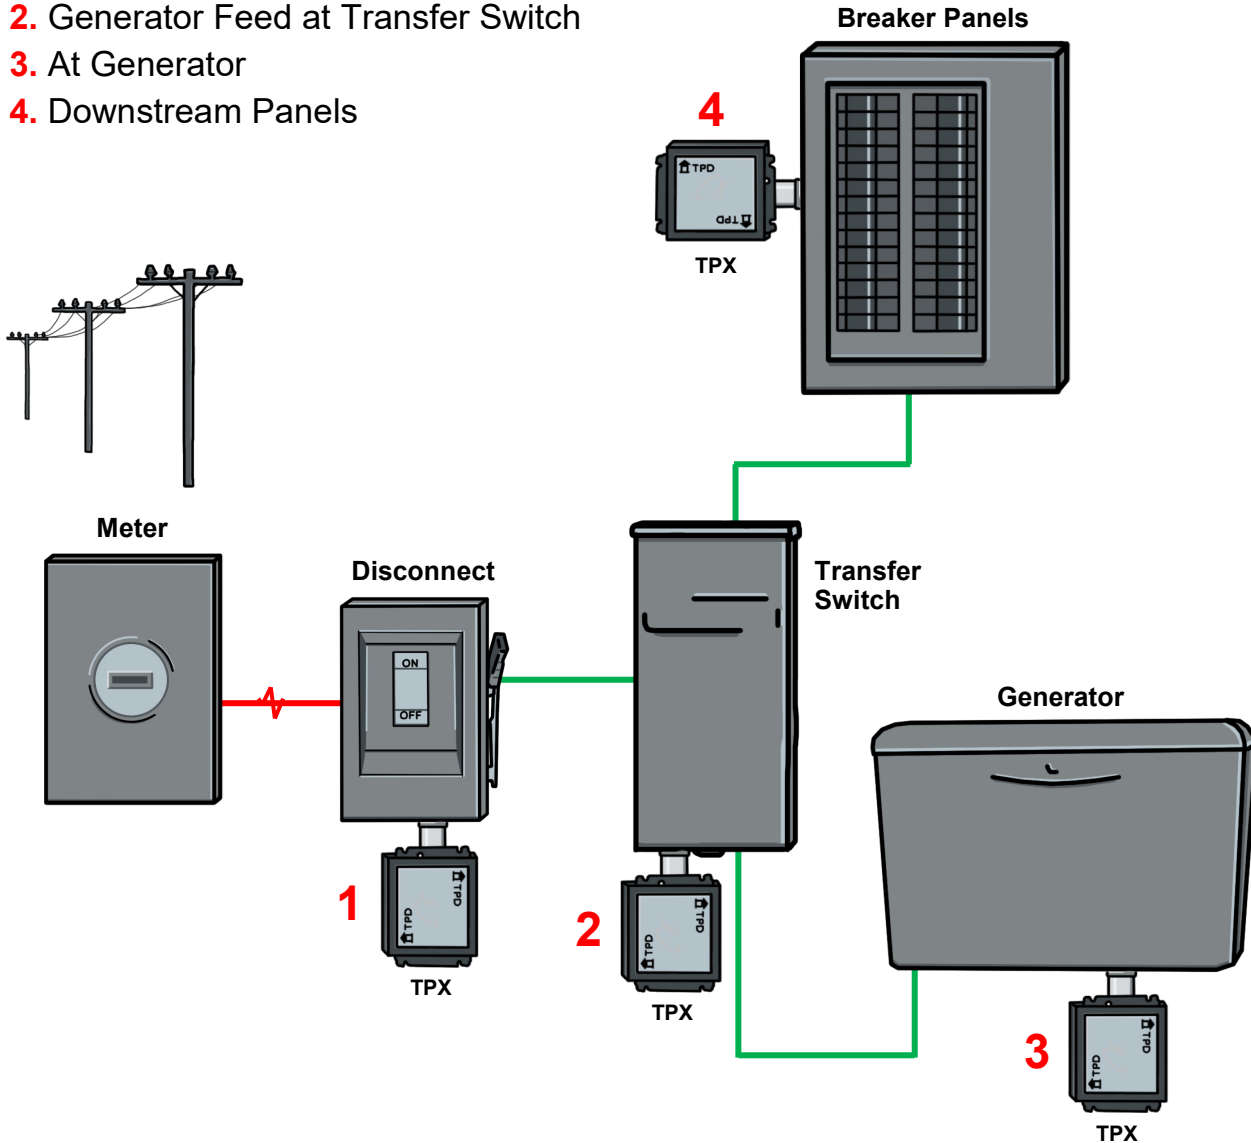

Note: Additional surge protection can be placed on the output of the transfer switch. This is done when the transfer switch is placed outside and is at risk of surges from lightning.

Call Technical Support at **717-436-2856** or email info@tpdsurge.com
www.TransientProtectionDesign.com